


SINGLE STORY ADDITION SAMPLE

ONLY FOR 35# ROOF SNOW LOAD & LOWER
DESIGNED REQUIRED FOR 5000 FT. ELEVATIONS & HIGHER

NOTE:
ATTIC VENTILATION IS
REQUIRED WHEN CEILING
IS CLOSED. 1/150th OF
FLOOR AREA IN GABLE
END VENTS.

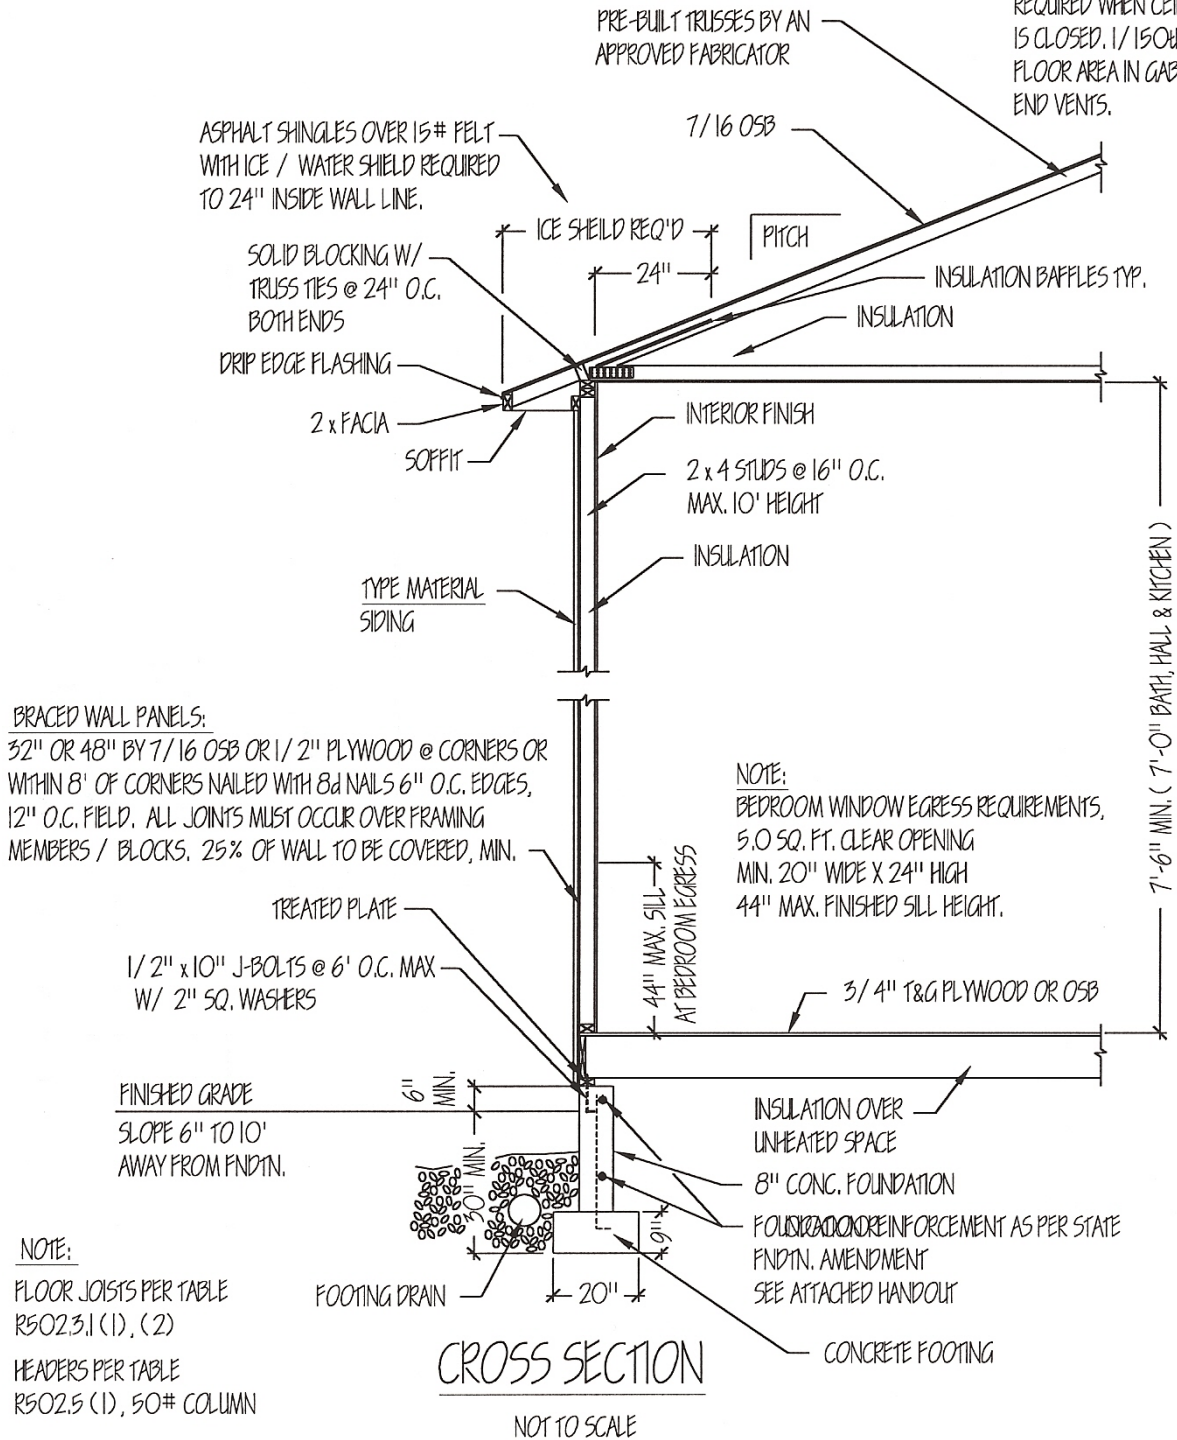

HANDOUT BASED ON CODE REQUIREMENTS & COMMON BUILDING PRACTICES